


Name of the work: Tender for Providing electrical supply to LT panel & Hot water generators installed at D&T OT block, AIIMS- Jodhpur.


N.I.T. No.: AIIMS-JD/H/EE/ELECT/2021-22/01

CORRIGENDUM / ADDEMDUM

| S. No. | Ref. Page No. of Document | Ref. no. of item | Existing specifications / item | Read as |
|--------|---------------------------|-----------------------------------|--|---|
| 1. | Page no. 24 / 34 | Technical specifications S. no. 1 | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1kV grade with Aluminium Unarmored conductor of IS:1554 P-1 / IS :7098 P-1 on surface / existing cable tray / support using cable ties making necessary connection, testing etc. as required of size. Make: Havells / Polycab / RRRKable / Finolex / Gloster. | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1kV grade with Aluminium Unarmored conductor of IS:1554 P-1 on surface / existing cable tray / support using cable ties making necessary connection, testing etc. as required of size. Make: Havells / Polycab / RRRKable / Finolex / Gloster |
| | | Technical specifications S. no. 3 | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1 KV grade with Aluminium Armoured conductor of IS:1554 P-1 / IS :7098 P - 1 on existing cable tray / support using cable ties making necessary connection, testing etc. as required of size. Make: Havells / Polycab / RRRKable / Finolex / Gloster | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1 KV grade with Aluminium Armoured conductor of IS:1554 P-1 in ground as per IS:1255 including excavation of 30cmx75cm size trench, 25 cm thick under layer of sand, II class bricks covering, refilling earth, compaction of earth, making necessary connection, testing etc. as required of size. |
| | | Technical specifications S. no. 5 | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1 KV grade with Aluminium Armoured conductor of IS:1554 P-1 / IS :7098 in ground as per IS:1255 including excavation of 30cmx75cm size trench, 25 cm thick under layer of sand, II class bricks covering, refilling earth, compaction of earth, making necessary connection, testing etc. as required of size. | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1 KV grade with Aluminium Armoured conductor of IS:1554 P-1 on existing cable tray / support using cable ties making necessary connection, testing etc. as required of size. Make: Havells / Polycab / RRRKable / Finolex / Gloster |
| | | Technical specifications S. no. 6 | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1 KV grade with Copper conductor of IS:1554 P-1 / IS :7098 P - 1 on existing cable tray / support using cable ties making necessary connection, testing etc. as required of size. Make: Havells / Polycab / RRRKable / Finolex / Gloster | Providing & Laying P.V.C. insulated & P.V.C. sheathed cable of 1.1 KV grade with Copper conductor of IS:1554 P-1 on existing cable tray / support using cable ties making necessary connection, testing etc. as required of size. Make: Havells / Polycab / RRRKable / Finolex / Gloster |


(Er. Harshit Bhandari)

Junior Engineer (E), AIIMS-Jodhpur

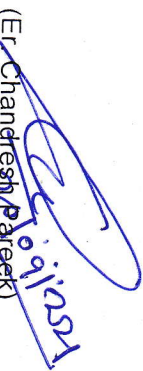
(Er. Chandresh P. Dheek)

Assistant Engineer (C), AIIMS-Jodhpur


(Mr. Aakash Manihar)

Accounts Officer, AIIMS-Jodhpur


(Er. Pankaj Saxena)

Executive Engineer (E), AIIMS-Jodhpur